


PLAN  
NTS

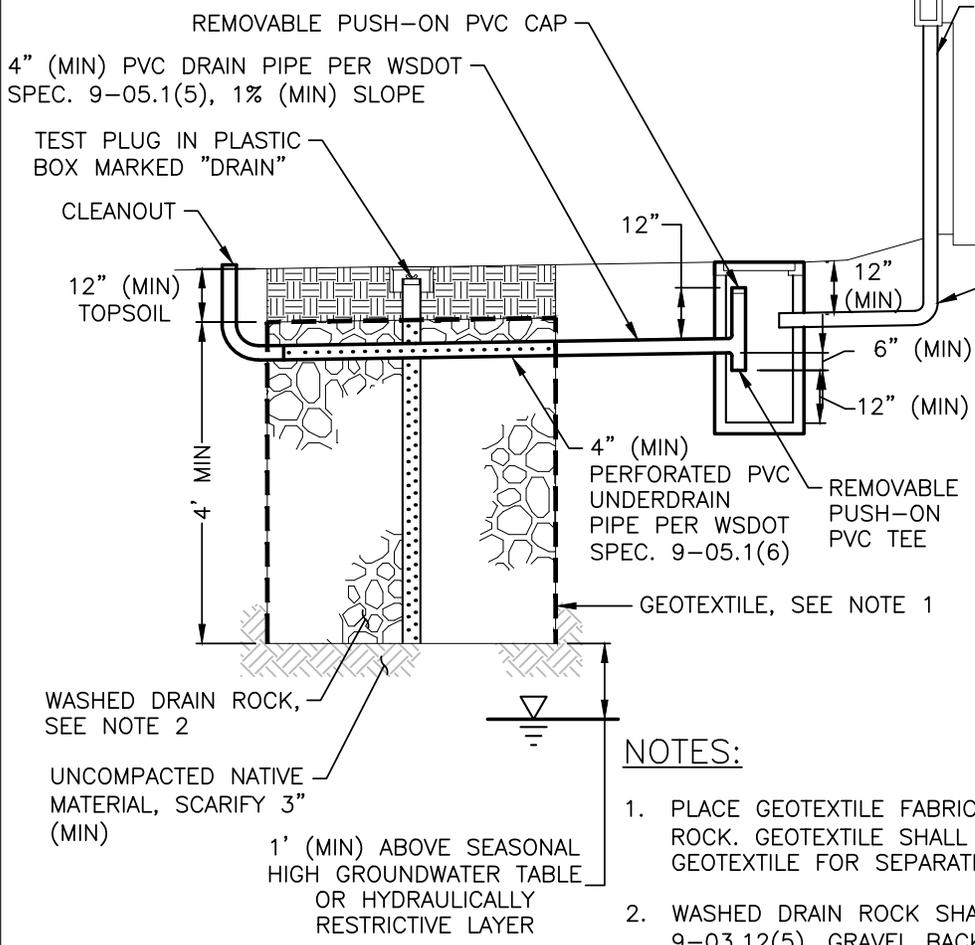

PROFILE  
NTS

GENERAL NOTES:

1. REFER TO THE 2017 CITY OF EDMONDS STORMWATER ADDENDUM FOR SETBACK (CHECKLIST 13) AND INFEASIBILITY REQUIREMENTS.
2. MINIMUM COVER DEPTHS ASSUME NO VEHICULAR LOADING. DESIGNER TO SPECIFY COVER DEPTHS IF VEHICULAR TRAFFIC ANTICIPATED.
3. PROVIDE 10 FEET (MIN) SPACING BETWEEN DRY WELLS.

NOTES:

1. PLACE GEOTEXTILE FABRIC ALONG WALLS AND TOP OF WASHED ROCK. GEOTEXTILE SHALL CONFORM TO WSDOT SPEC. 9-33.2(1), GEOTEXTILE FOR SEPARATION, NON-WOVEN TYPE.
2. WASHED DRAIN ROCK SHALL CONFORM TO WSDOT SPEC. 9-03.12(5), GRAVEL BACKFILL FOR DRYWELLS.
3. OBSERVATION WELL SHALL CONFORM TO WSDOT SPEC. 9-05.2(6), PERFORATED PVC UNDERDRAIN PIPE.



**CITY OF EDMONDS**  
PUBLIC WORKS  
DEPARTMENT

**TYPICAL DOWNSPOUT  
INFILTRATION DRYWELL**

APPROVED BY: R. ENGLISH

REVISION DATE  
DECEMBER 2017

STANDARD  
DETAIL  
**SD-638**