



CITY INSPECTION REQUIRED ON FORM WORK PRIOR TO POUR

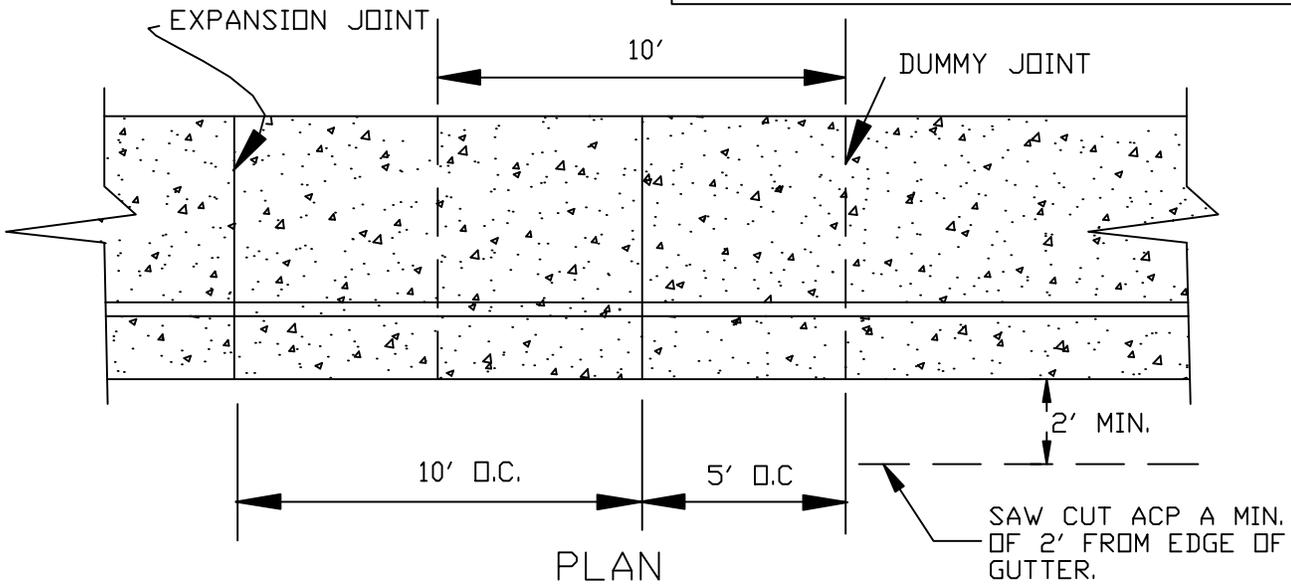


FULL DEPTH 1/2" EXPANSION JOINT MATERIAL

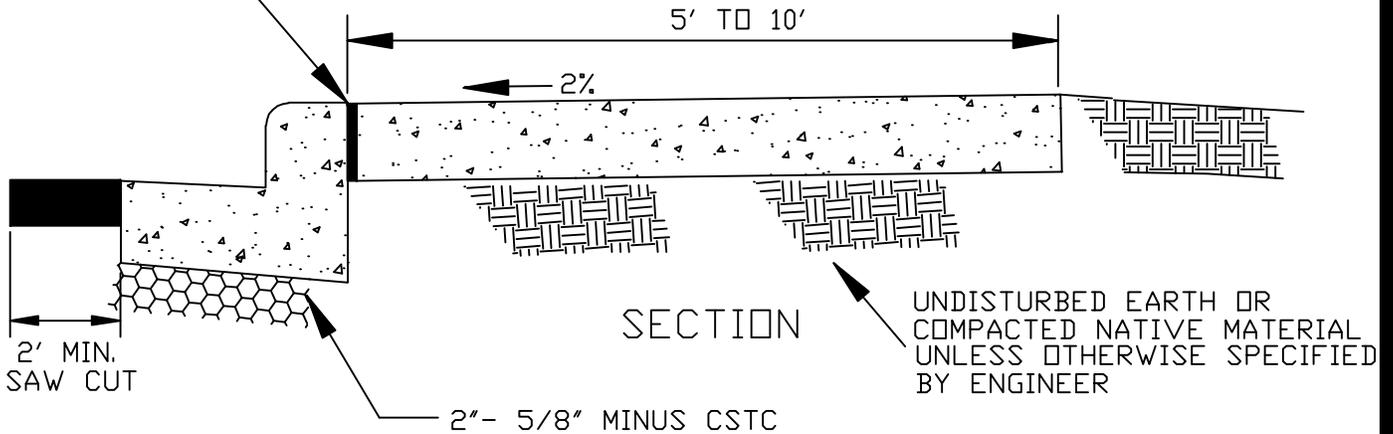

NOTE:

1. CONCRETE SHALL BE CLASS 3- 3000PSI
2. CONCRETE SHALL BE BROOM FINISHED
3. SIDEWALK THICKNESS SHALL BE 5-1/2".
4. SIDEWALK THICKNESS AT DRIVEWAYS SHALL BE 6" THICK.
5. CURB AND GUTTER SHALL BE POURED SEPARATELY FROM SIDEWALK
6. CONCRETE SHALL BE SPRAYED WITH CLEAR CURING COMPOUND OR SHALL BE COVERED AND KEPT MOIST FOR 72 HOURS.
7. SAW CUT AND REMOVE ACP PAVEMENT A MIN. OF 2' FROM GUTTER FACE TO INSURE ADEQUATE COMPACTION OF ACP AND GUTTER SUBGRADE



CITY OF EDMONDS

STANDARD DETAIL

REVISIONS	
APPROVED BY	DATE
D. GEBERT	4/27/05
D. GEBERT	04/2/07

DATE 7/24/01

SCALE NTS

DWG NO. E2.13

CONCRETE SIDEWALK