


12' RESIDENTIAL MINIMUM
24' MAX. (2-CAR GARAGE)
30' MAX. (3-CAR GARAGE)
(COMMERCIAL)


NOTE:

1. IF DRIVEWAY WIDTH EXCEEDS 15', INSTALL A FULL DEPTH EXPANSION JOINT.
 2. DRIVEWAY APRON SHALL BE A MINIMUM OF 6" THICK AND SHALL BE PLACED ON 2" OF 5/8" CSTC AND COMPACTED GRADE.
 3. A MINIMUM 2' SAW CUT IS REQUIRED IN THE ASPHALT WHERE NEW CURB / GUTTER IS PLACED (SEE DETAIL ABOVE).
- CONCRETE SHALL BE CLASS 3- 3000PSI

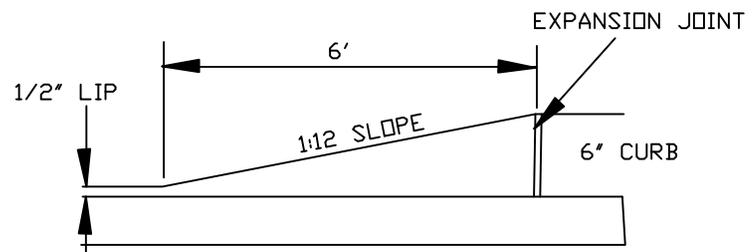

DRIVEWAY CURB TRANSITIONAL DETAIL FOR CURB AND GUTTER OR VERTICAL CURBS

CURB AND GUTTER SHALL BE POURED SEPARATELY FROM THE SIDEWALK. CITY INSPECTION REQUIRED ON FORM WORK PRIOR TO POUR.



CITY OF EDMONDS

STANDARD DETAIL

STANDARD DRIVEWAY ENTRANCE

REVISIONS	
APPROVED BY	DATE
D. GEBERT	10/6/03
D. GEBERT	01/15/08

DATE	7/24/01	SCALE	NTS	DWG NO.	E226
------	---------	-------	-----	---------	-------------