



NOTE:  
\*CDF SHALL BE 3/4 SACK MIX  
DESIGN PER WSDOT STANDARDS

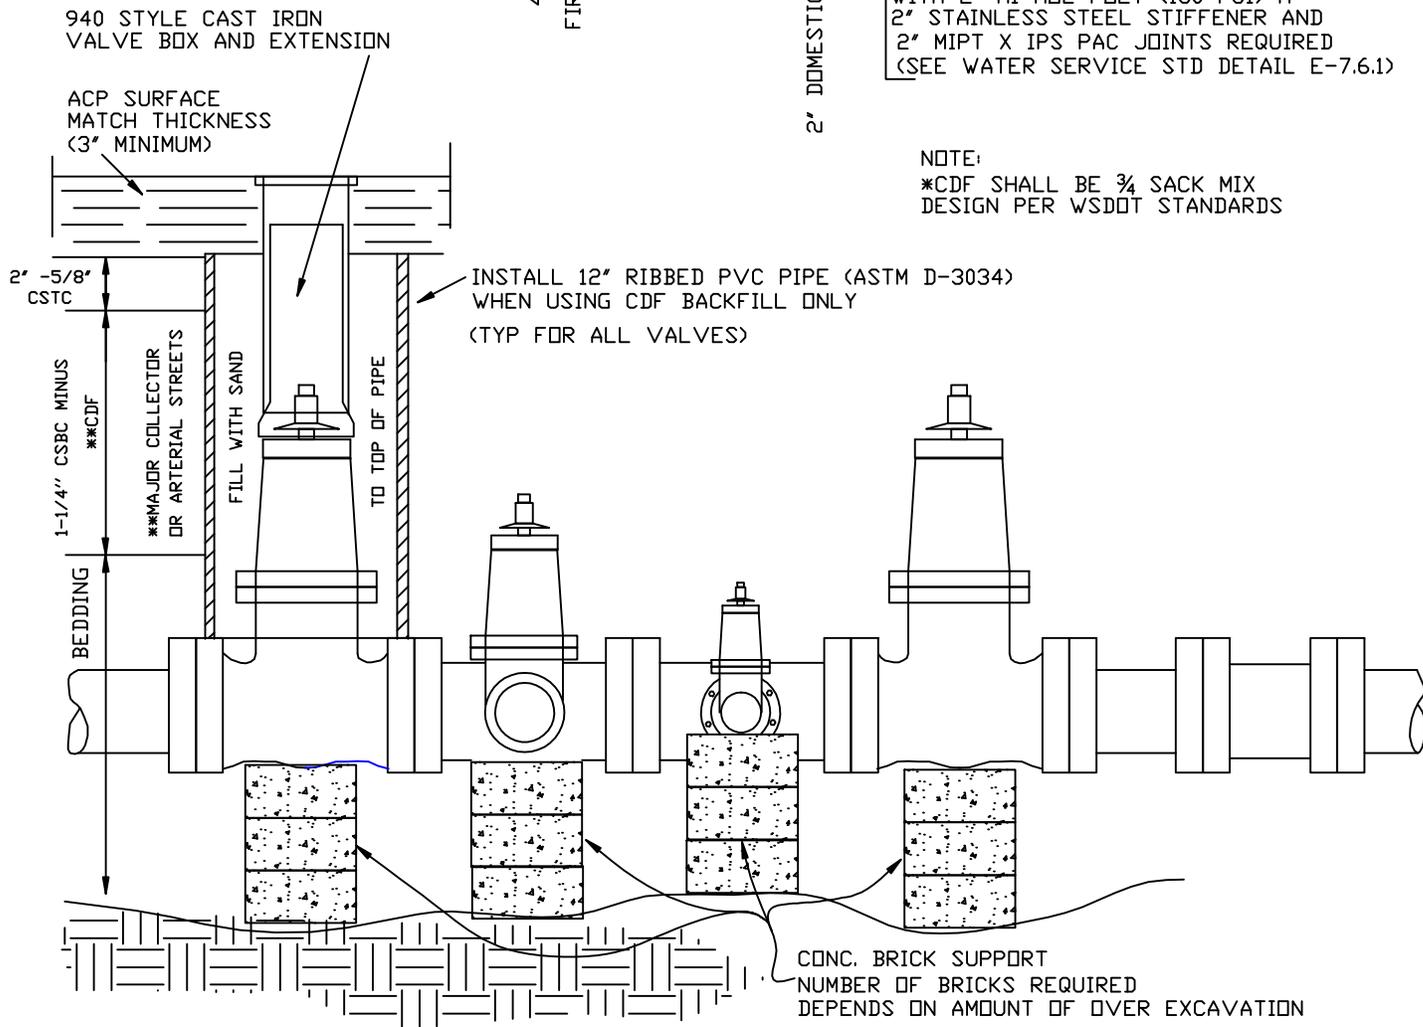

# CITY OF EDMONDS

REVISIONS	
APPROVED BY	DATE
D. GEBERT	4/2/07

## STANDARD DETAIL

### FIRE LINE AND 2" DOMESTIC SERVICE CONNECTIONS (DETAILS)

DATE	SCALE	DWG NO.
07/12/05	NTS	E7.18